




MONTEREY COUNTY REGIONAL FIRE DISTRICT PREVENTION DIVISION

ACCEPTABLE FIRE SPRINKLER / DOMESTIC HOOK-UPS

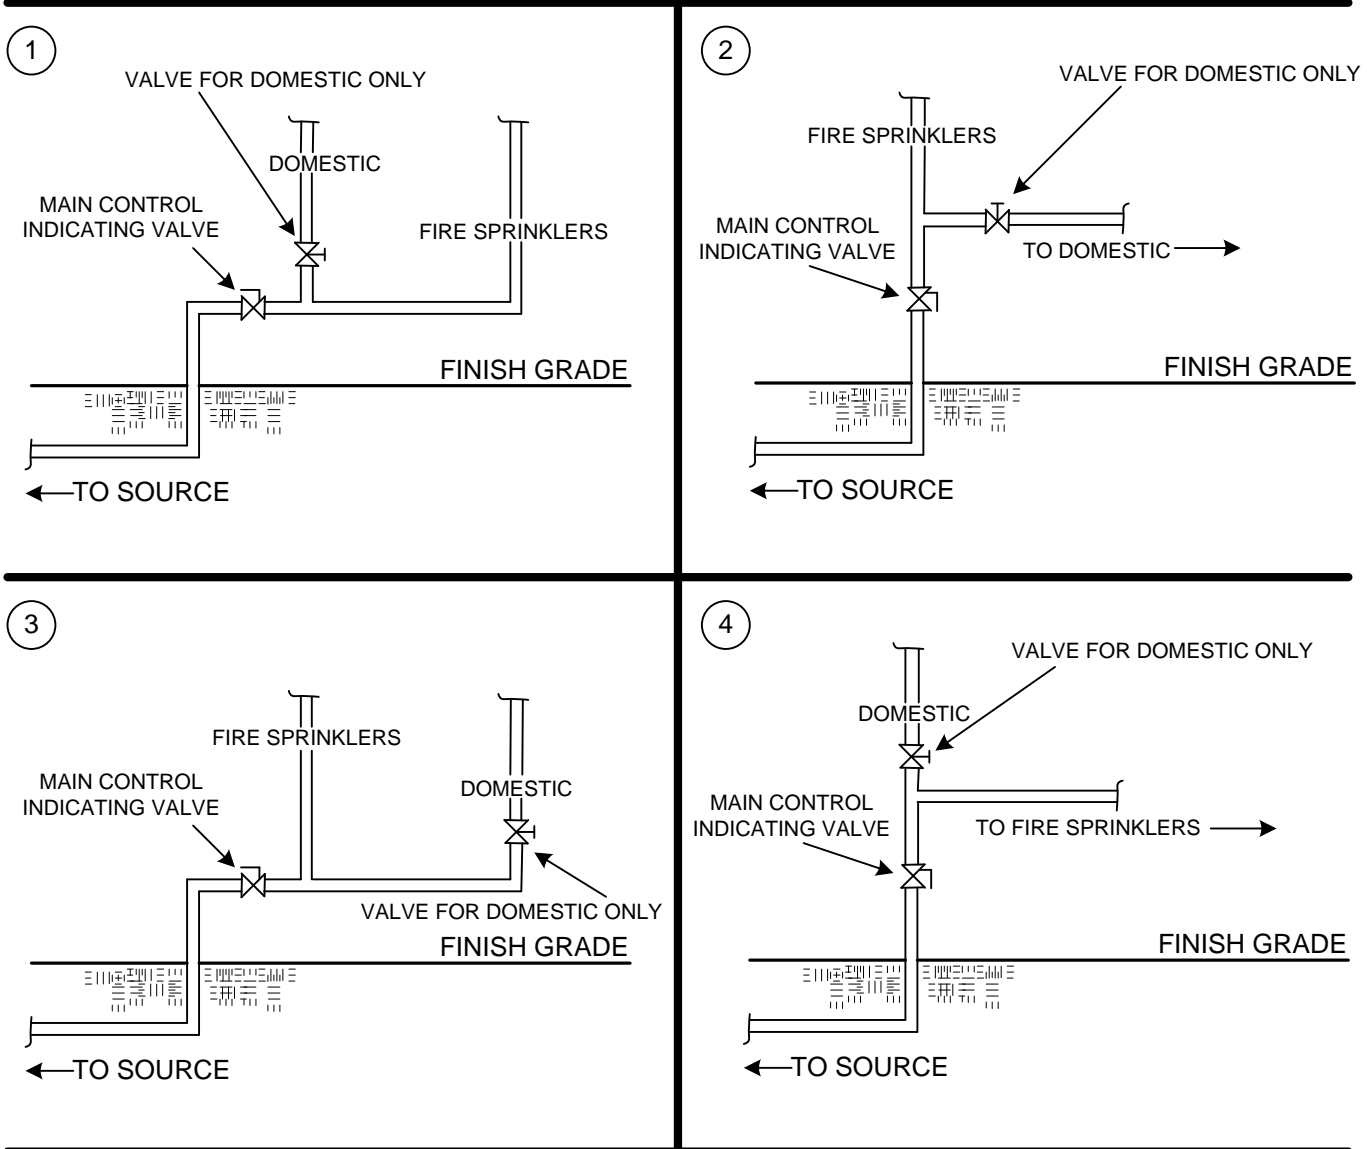

1. AN INDICATING-TYPE VALVE SHALL BE INSTALLED IN A LOCATION WHERE IT SHUTS OFF BOTH THE FIRE SPRINKLER AND THE DOMESTIC SYSTEMS.
2. INDICATING VALVE SHALL BE INSTALLED ABOVE FINISHED GRADE.
3. BALL-TYPE VALVE IS ACCEPTABLE; GATE VALVES ARE NOT ALLOWED.
4. SEPARATE VALVE FOR THE FIRE SPRINKLER SYSTEM IN NOT ALLOWED.
5. UNDERGROUND PIPING TO BE FLUSHED PRIOR TO RISER CONNECTION.
6. FIRE SPRINKLER ALARM TO BE WIRED TO REFRIGERATOR CIRCUIT.
7. A SEPERATE VALVE SHALL BE INSTALLED FOR DOMESTIC SYSTEM ONLY SO THE FIRE SPRINKLER SYSTEM CAN REMAIN IN OPERATION DURING DOMESTIC SYSTEM REPAIRS.